

Baseboard System (Three Way Zone Valve Controlled)


NOTE

Outdoor furnace water temperature setpoint should be set at 185°F minimum.

This horizontal assembly must not exceed a height of 4 inches above top of water heater.

NOTE

A pump must be installed in the hot supply line between the outdoor furnace and thermostatic valve.

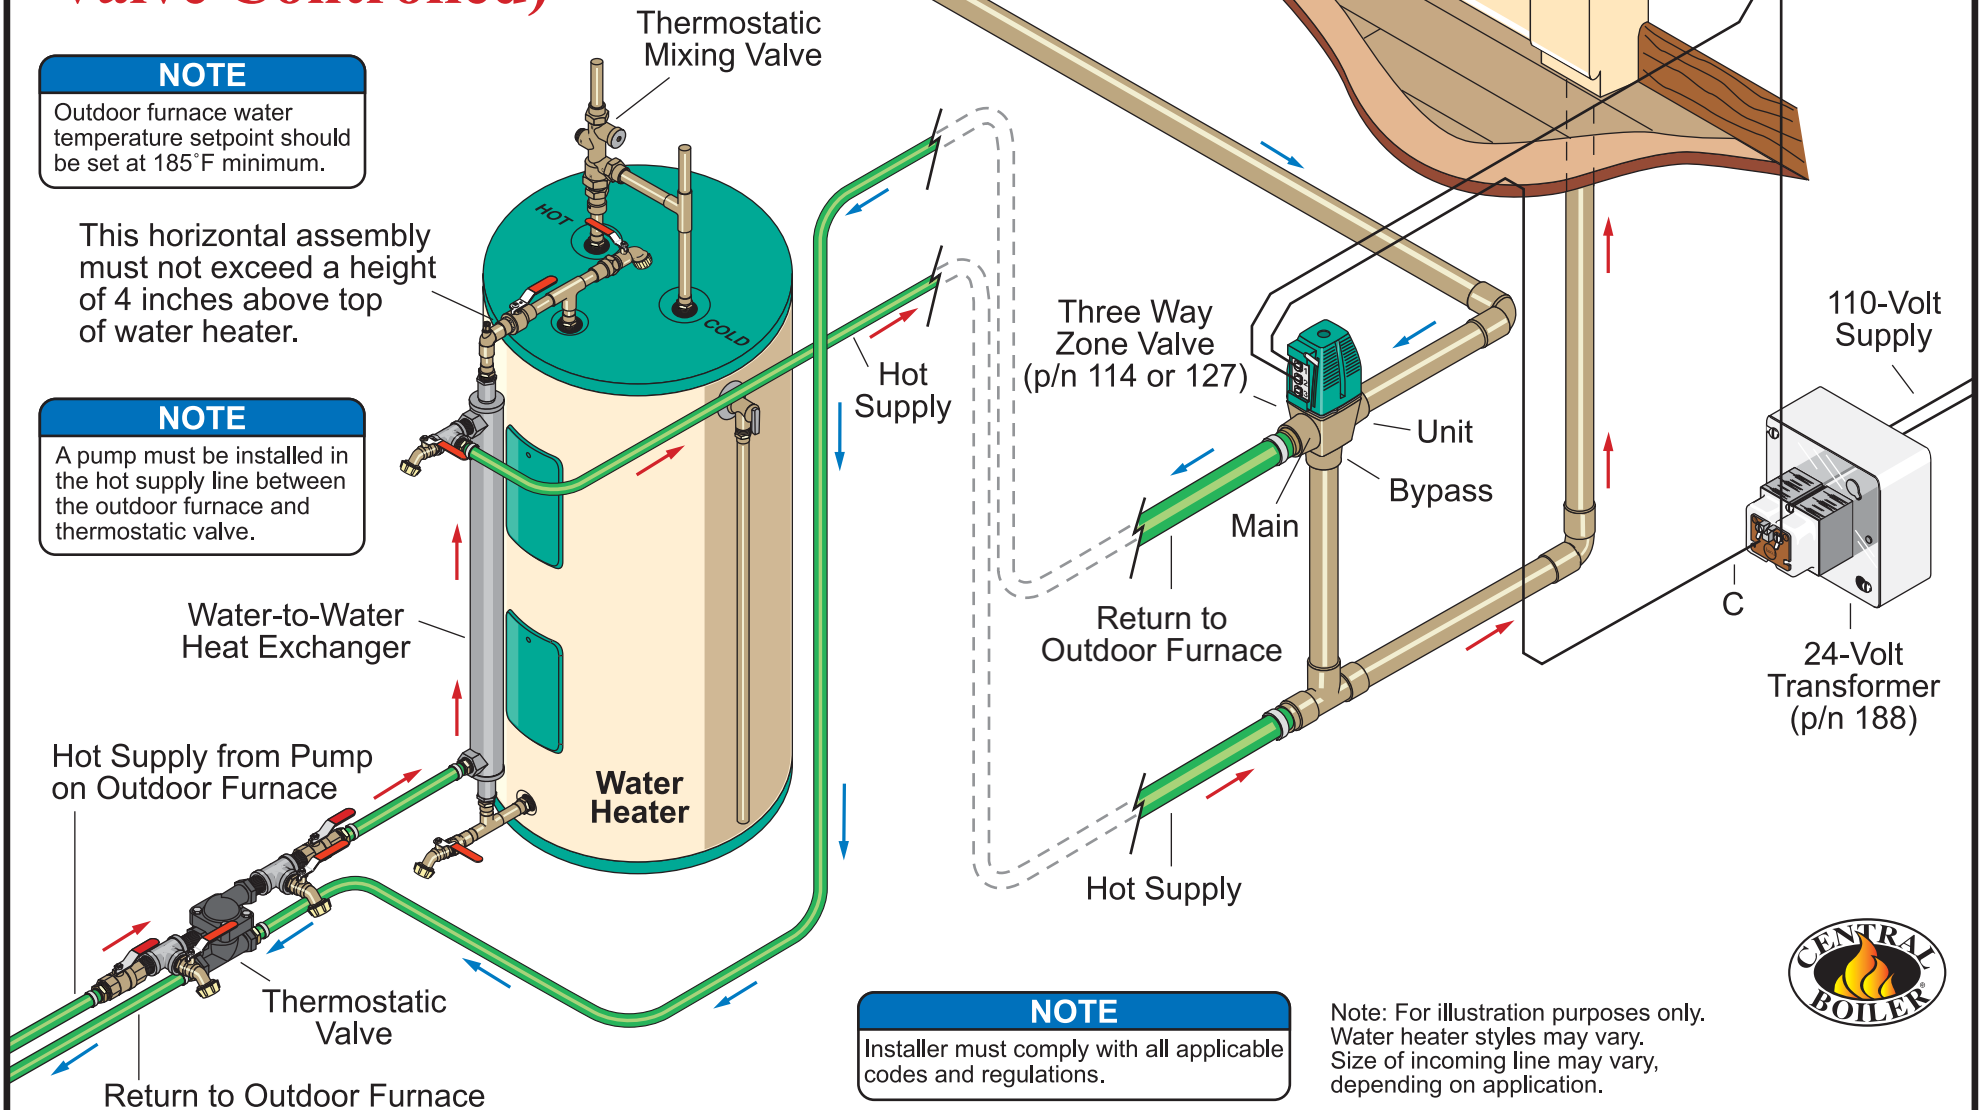

NOTE

Installer must comply with all applicable codes and regulations.

Note: For illustration purposes only. Water heater styles may vary. Size of incoming line may vary, depending on application.

