

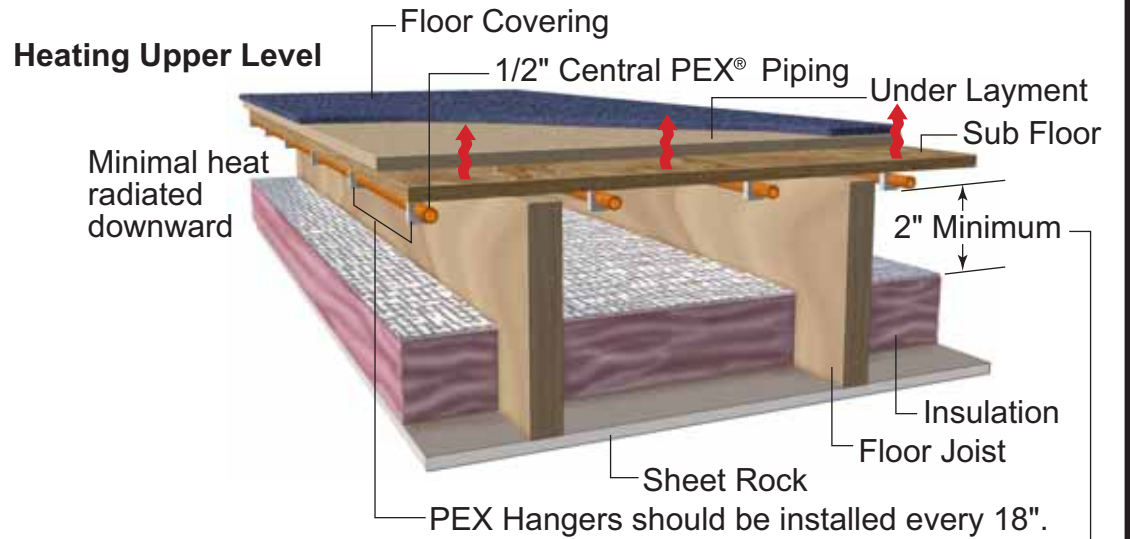


Radiant Floor Heat

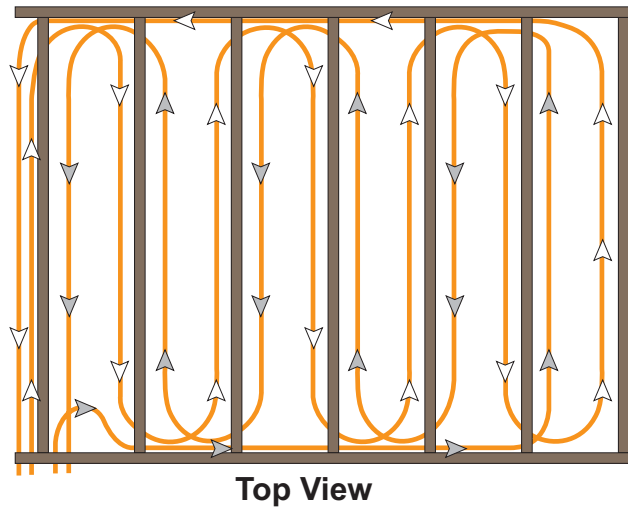

It is recommended that you maintain a 2" cavity between piping and insulation for best performance.

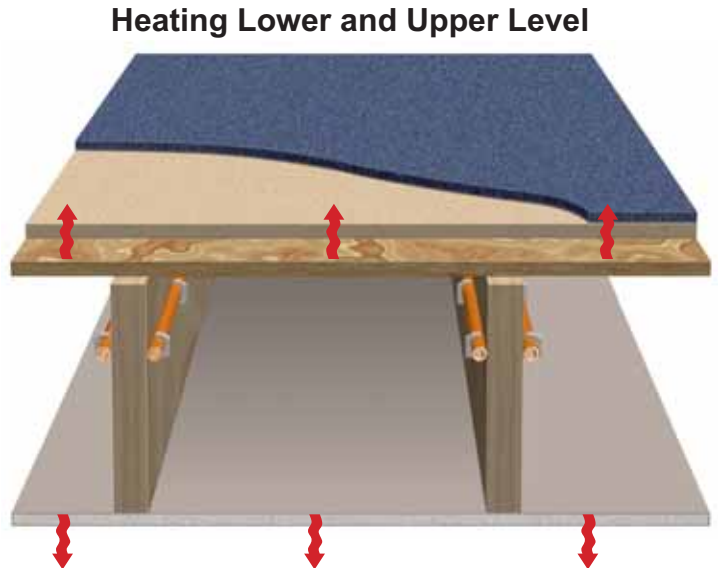